



Coenco Inc.


## Franks Office

---

*Even temperatures with Traditional  
Equipment with the addition of a  
Coenco Ultra Quiet RAM-II 18 for  
adequate distribution*

---



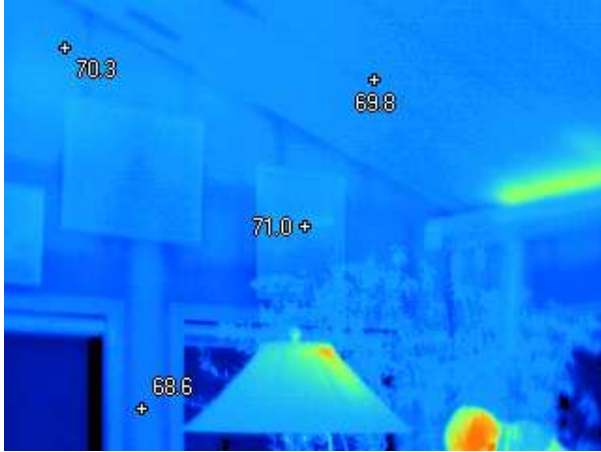

**IR20081201\_0003.is2**

**Visible Light Image**

12/1/2008 11:21:02 AM

***Image Info***

Average Temperature	69.1 °F
Calibration Range	-4.0 °F to 662.0 °F
Camera Model	Ti55FT
Image Range	51.6 °F to 91.6 °F
Image Time	12/1/2008 11:21:02 AM
Manufacturer	Fluke
Camera Serial Number	Ti55FT-0608096



**IR20081201\_0004.is2**

12/1/2008 11:21:21 AM



**Visible Light Image**

***Image Info***

Average Temperature	65.6 °F
Calibration Range	-4.0 °F to 662.0 °F
Camera Model	Ti55FT
Image Range	55.5 °F to 80.8 °F
Image Time	12/1/2008 11:21:21 AM
Manufacturer	Fluke
Camera Serial Number	Ti55FT-0608096




**IR20081201\_0005.is2**

**Visible Light Image**

12/1/2008 11:21:38 AM

***Image Info***

Average Temperature	68.1 °F
Calibration Range	-4.0 °F to 662.0 °F
Camera Model	Ti55FT
Image Range	53.8 °F to 82.2 °F
Image Time	12/1/2008 11:21:38 AM
Manufacturer	Fluke
Camera Serial Number	Ti55FT-0608096

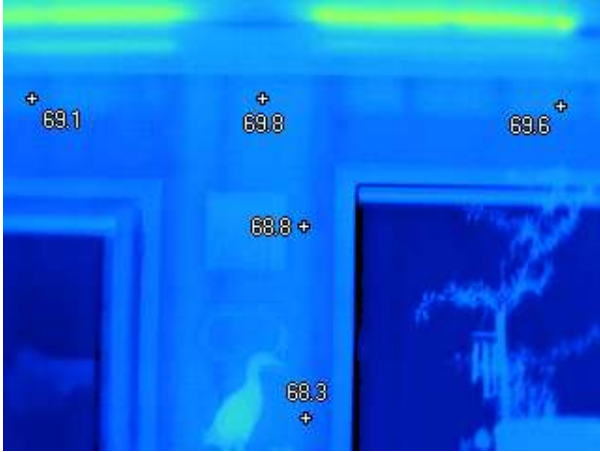


**IR20081201\_0006.is2**

**Visible Light Image**

12/1/2008 11:21:50 AM

***Image Info***

Average Temperature	67.1 °F
Calibration Range	-4.0 °F to 662.0 °F
Camera Model	Ti55FT
Image Range	55.2 °F to 81.7 °F
Image Time	12/1/2008 11:21:50 AM
Manufacturer	Fluke
Camera Serial Number	Ti55FT-0608096

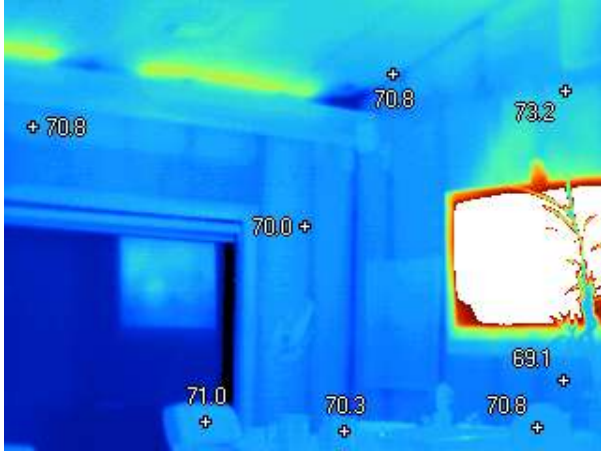

**IR20081201\_0007.is2**

**Visible Light Image**


12/1/2008 11:22:06 AM

Notice contents of room are same temp.

Chair  
Mug  
Etc.

### ***Image Info***

Average Temperature	73.0 °F
Calibration Range	-4.0 °F to 662.0 °F
Camera Model	Ti55FT
Image Range	53.8 °F to 133.7 °F
Image Time	12/1/2008 11:22:06 AM
Manufacturer	Fluke
Camera Serial Number	Ti55FT-0608096

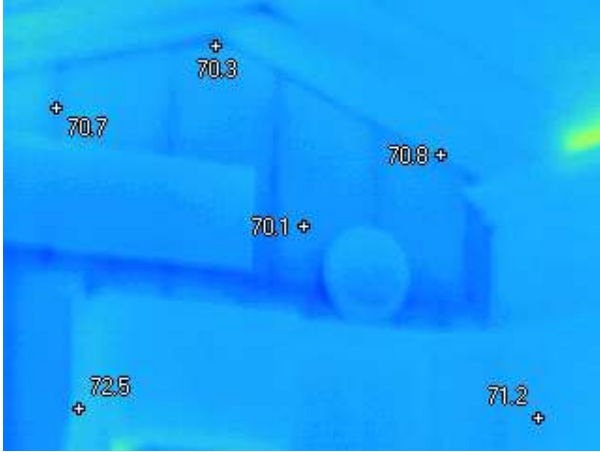

**IR20081201\_0008.is2**

**Visible Light Image**

12/1/2008 11:22:22 AM

***Image Info***

Average Temperature	70.9 °F
Calibration Range	-4.0 °F to 662.0 °F
Camera Model	Ti55FT
Image Range	64.7 °F to 81.5 °F
Image Time	12/1/2008 11:22:22 AM
Manufacturer	Fluke
Camera Serial Number	Ti55FT-0608096



**IR20081201\_0009.is2**

**Visible Light Image**

12/1/2008 11:22:40 AM

***Image Info***

Average Temperature	69.9 °F
Calibration Range	-4.0 °F to 662.0 °F
Camera Model	Ti55FT
Image Range	64.7 °F to 87.5 °F
Image Time	12/1/2008 11:22:40 AM
Manufacturer	Fluke
Camera Serial Number	Ti55FT-0608096



**IR20081201\_0010.is2**

**Visible Light Image**

12/1/2008 11:22:58 AM

***Image Info***

Average Temperature	70.8 °F
Calibration Range	-4.0 °F to 662.0 °F
Camera Model	Ti55FT
Image Range	65.0 °F to 105.9 °F
Image Time	12/1/2008 11:22:58 AM
Manufacturer	Fluke
Camera Serial Number	Ti55FT-0608096



**IR20081201\_0012.is2**

**Visible Light Image**

12/1/2008 12:04:49 PM

***Image Info***

Average Temperature	26.3 °F
Calibration Range	-4.0 °F to 662.0 °F
Camera Model	Ti55FT
Image Range	16.0 °F to 38.8 °F
Image Time	12/1/2008 12:04:49 PM
Manufacturer	Fluke
Camera Serial Number	Ti55FT-0608096